

Alarm Status

Lower	✓	OK
Upper	✓	OK

Recorder Info

Serial #: D80202881490	Model: TRIX-8	Battery: OK	Trip #: 1
Description:			

Recorder Configuration

Start type : Push button start	Temperature alarms
Start delay : None	Lower : -4.0 °F
Interval : 5 Minutes	Upper : 158.0 °F
Alert indicator : Enabled lower & upper	
OK indicator : Enabled	

Recorded Data


First reading : 3/6/2026 3:22:56 PM	Temperature statistics
Last reading : 3/16/2026 7:32:56 AM	Lowest : 38.6 °F
Elapsed time : 9 Days 16 Hours 15 Minutes	@ 3/14/2026 8:37:56 AM
Total readings : 2787	Highest : 66.3 °F
First evaluated : 3/13/2026 2:52:56 PM	@ 3/13/2026 3:12:56 PM
Last evaluated : 3/16/2026 7:17:56 AM	Average reading: 39.9 °F
Evaluated Time : 2 Days 16 Hours 30 Minutes	Standard Deviation: 2.3 °F(S)
Evaluated Readings : 774	MKT(Δ H 83.144): 40.2 °F

Lower Alarm

Triggered: (none)
Time below/equal: (none)
Occurrences : 0
°F - Minutes below : 0.00

Upper Alarm

Triggered: (none)
Time above/equal: (none)
Occurrences : 0
°F - Minutes above : 0.00

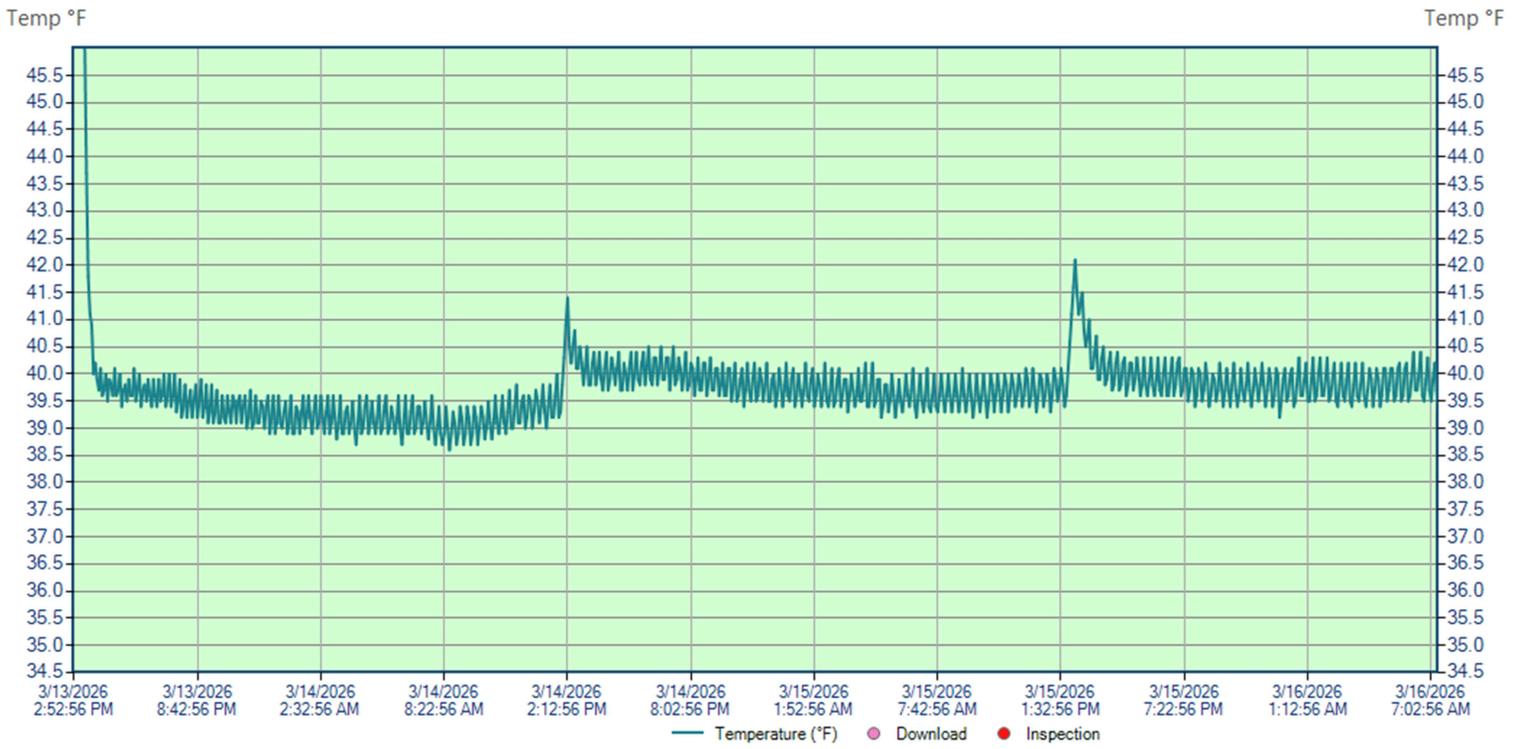

Events Info

3/13/2026 3:17:56 PM	Inspection
----------------------	------------

McCray - SC-CDS35-6-B