



SUPERIOR HOODS

2018 STEEL DRIVE TUCKER GA 30084
 TEL (770) 936-0770 FAX (770) 936-9914

DATE: _____

NAME: _____

LOCATION: _____

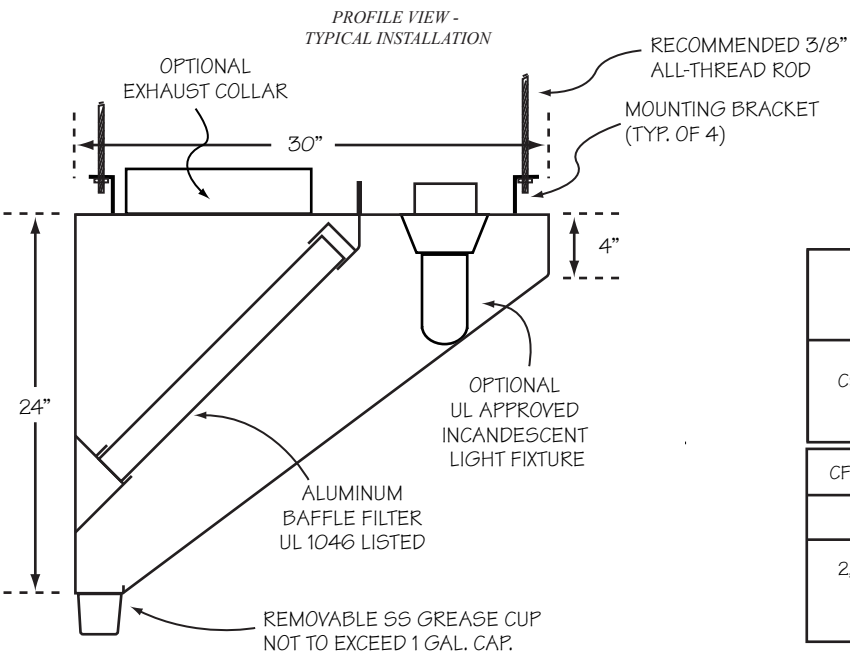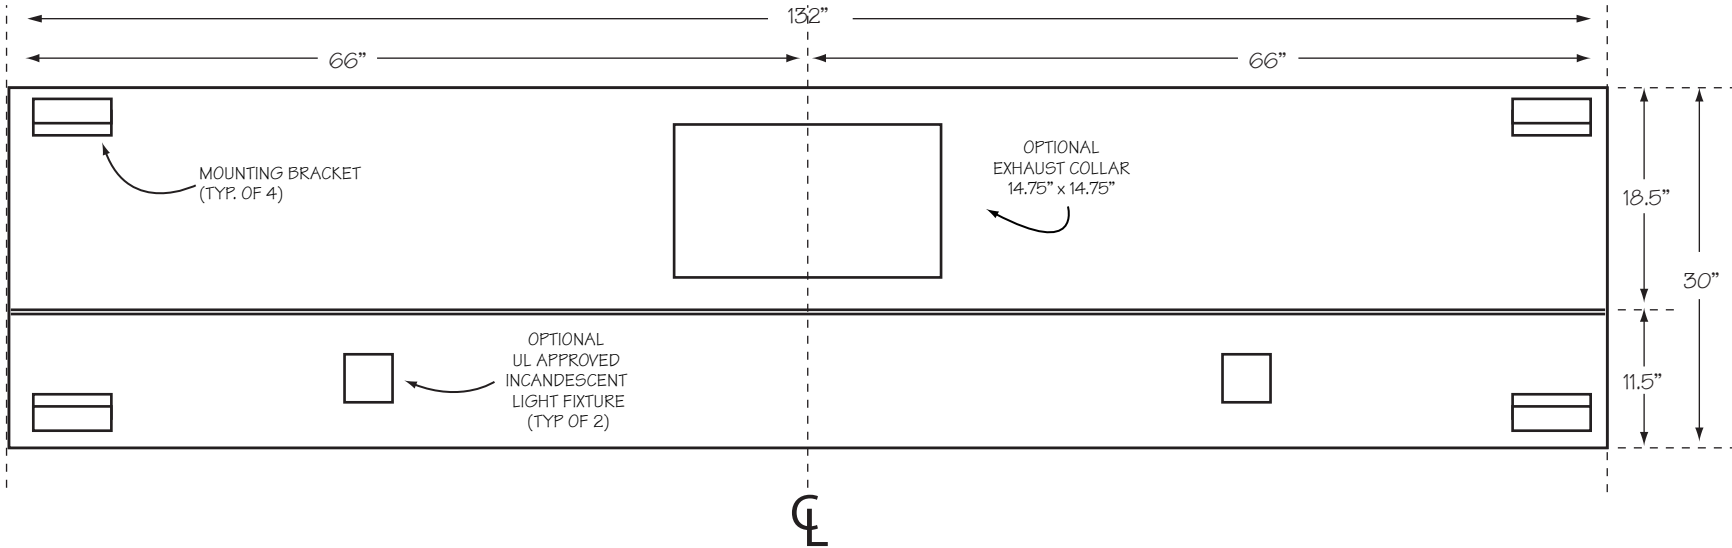

CSS30-11
 STAINLESS STEEL EXHAUST HOOD
 N.S.F. LISTED. CONFORMS TO NFPA96
 Hood Constructed with continuous liquid-tight weld in conformance to IMC 2012:
"507.7.1 Type I hoods. External hood joints, seams and penetrations for Type I hoods shall be made with a continuous external liquid-tight weld or braze to the lowest outermost perimeter of the hood. Internal hood joints, seams, penetrations, filter support frames and other appendages attached inside the hood shall not be required to be welded or brazed but shall be otherwise sealed to be grease tight."

HOOD INFORMATION

| MODEL | LENGTH | WIDTH | HEIGHT | HOOD CONSTRUCTION | FILTERS | | | | LIGHTS | | |
|-----------------------------|--------|--------------------|--------------|--|--|-------------------------------|--------|--------|--------|--|--|
| | | | | | TYPE | QTY | HEIGHT | LENGTH | QTY | TYPE | |
| CSS30-11 | 11' | 30" | 24" | TYPE: ALL 430 S/S GAUGE: 18 POLISH: #3 | ALUMINUM BAFFLE w/HANDLES UL APPROVED | 4 | 20" | 20" | 2 | INCANDESCENT LIGHT FIXTURE UL APPROVED | |
| | | | | | | 2 | 20" | 25" | | | |
| CFM REQUIREMENTS (PER HOOD) | | COLLARS (PER HOOD) | | | | ACCESSORIES | | | | | |
| EXHAUST | SUPPLY | EXHAUST | SUPPLY | STANDOFF | OTHER: | | | | | | |
| 2,750 @ .5 S.P. | | QTY | SIZE | QTY | SIZE | <input type="checkbox"/> NONE | | | | | |
| | | 1 | 14.75" X 22" | | | <input type="checkbox"/> 3" | | | | | |
| | | | | <input type="checkbox"/> | | | | | | | |