



**FREEZER**

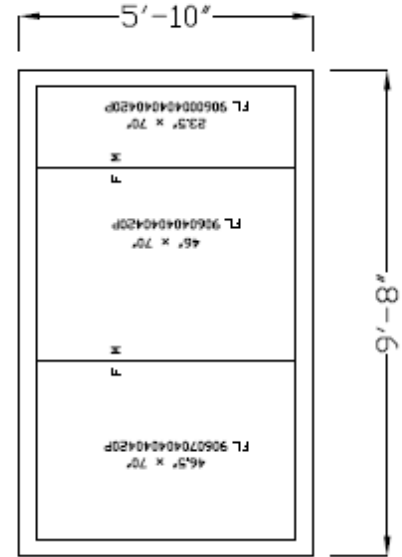


**FLOOR PANELS**


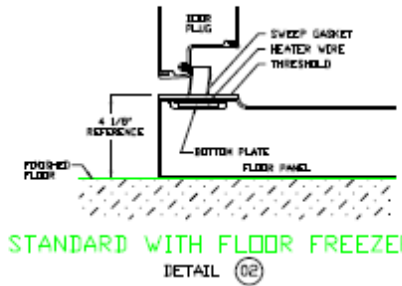


**STANDARD WITH FLOOR FREEZER**

**OPTION A DOOR SWING**

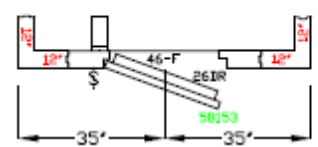

**OPTION B DOOR SWING**

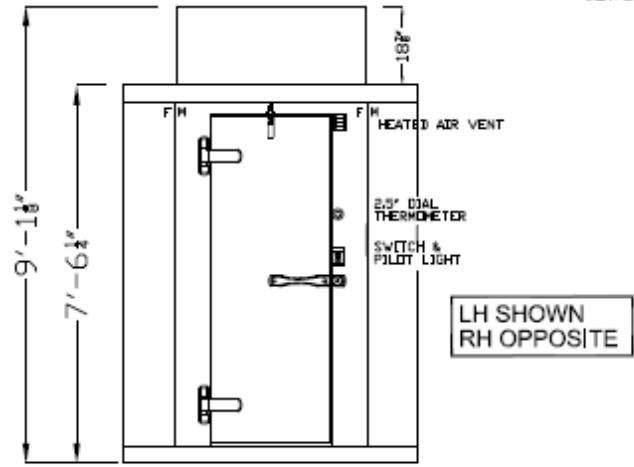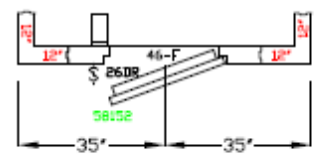

**DOOR ELEVATION**  
46x7DS 26x7B DR P-P-FRZ STD  
THRESHOLD DETAIL 02

**WALK-IN SPECIFICATIONS**

**SIZE:** 5'-10" X 9'-8" X 7'-6 1/4"  
**PANELS:**

ALL FOAMED PANELS ARE 4"

**EXTERIOR FINISH:**

ALL 26GA STUCCO GALVALUME

**INTERIOR FINISH:**

ALL 26GA STUCCO GALVALUME

**FLOOR TYPE:**

FREEZER - .100 SMOOTH ALUMINUM

**HEIGHT:**

DD 7'-6 1/4" ID 6'-10 5/8"

**DOORS:**

46x82.25DS 26x7B DR STD FRZ  
115-60-1/1.9 AMPS

**ACCESSORIES:**

(NONE)

**REFRIG.**

PF144T3 1 1/2HP 208/230/60/1 12.9 AMPS

**USE this drawing for installation**



**IMPORTANT NOTES:**

- 1) ALLOW MINIMUM 1" CLEARANCE ALL AROUND WALK-IN.
- 2) WALK-IN CEILING IS NOT DESIGNED FOR FOOT TRAFFIC OR STORAGE.
- 3) GENERAL CONTRACTOR TO REFER TO DESIGN AND SPECIFICATIONS MANUAL FOR FLOOR DETAIL INFORMATION.
- 4) SPECIAL NOTE TO GENERAL CONTRACTOR AND SUBCONTRACTOR FOR QUARRY TILE OR CONCRETE WEARING FLOOR - THE SHEET METAL PANEL FACINGS MAY BE SUSCEPTABLE TO STAINING DUE TO EXCESSIVE MOISTURE CREATED BY THE HYDRATION OF CONCRETE TYPE MATERIALS. THEREFORE, IT IS ABSOLUTELY NECESSARY THAT EACH ROOM BE PROPERLY VENTILATED. ALSO NOTE THAT SPECIAL PRECAUTIONS MUST BE TAKEN WHEN USING MURIC ACID DUE TO EFFECTS HYDROCHLORIC ACID FUMES HAVE ON ALUMINUM AND STAINLESS STEEL MATERIALS.

|   |                                 |              |            |
|---|---------------------------------|--------------|------------|
| SCALE:  | 3/8"=1'-0"                      | DRAWING NO.: | P7-0610-FT |
| DRAWN BY:   | SB                              | DATE:        | 06/05/10   |
| DEALER:   | PROJECT: 5'-10"X9'-8"X7'-6 1/4" |              |            |
| 2015 TENNESSEE AVENUE NORTH<br>P.O. BOX 650<br>FARRISBURG, TN 38568<br>(601) 647-0361 |                                 |              |            |
| <b>KOLPAK</b><br>WALK-INS   |                                 |              |            |