

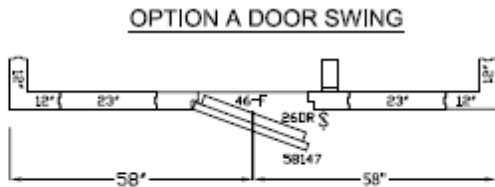
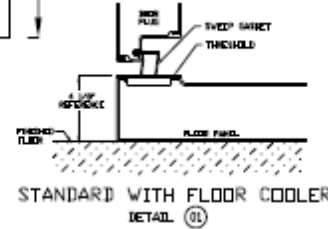
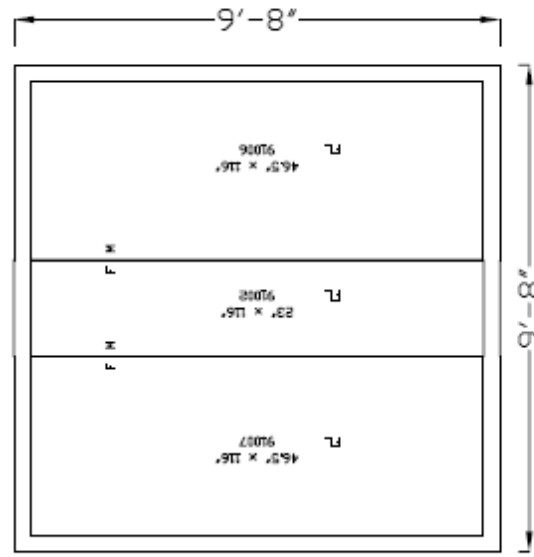


COOLER

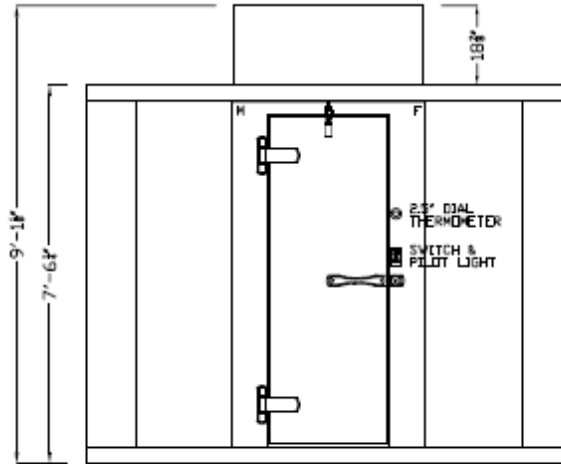

OPTION B DOOR SWING

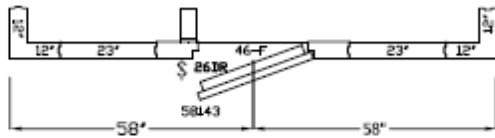

DOOR ELEVATION  
46x82.25DS 26x78 DR P-P-CLR STD  
THRESHOLD DETAIL 01

**WALK-IN SPECIFICATIONS**

**SIZE:** 9'-8" X 9'-8" X 7'-6 1/4"

**PANELS:**

ALL FOAMED PANELS ARE 4"

**EXTERIOR FINISH:**

ALL 26GA STUCCO GALVALUME

**INTERIOR FINISH:**

ALL 26GA STUCCO GALVALUME

**FLOOR TYPE:**

COOLER - .100 SMOOTH ALUMINUM

**HEIGHT:**

OD 7'-6 1/4" ID 6'-10 5/8"

**DOORS:**

46x82.25DS 26x78 DR STD CLR  
115-60-1/1.0 AMPS

**ACCESSORIES:**

(NONE)

**REFRIG.**

PC099T2C 1HP 115/60/1 16.8 AMPS  
EC FAN MOTORS

**USE this drawing for Installation**



**IMPORTANT NOTES:**

- 1) ALLOW MINIMUM 1" CLEARANCE ALL AROUND WALK-IN.
- 2) WALK-IN CEILING IS NOT DESIGNED FOR FOOT TRAFFIC OR STORAGE.
- 3) GENERAL CONTRACTOR TO REFER TO DESIGN AND SPECIFICATIONS MANUAL FOR FLOOR DETAIL INFORMATION.
- 4) SPECIAL NOTE TO GENERAL CONTRACTOR AND SUBCONTRACTOR FOR QUARRY TILE OR CONCRETE WEARING FLOOR - THE SHEET METAL PANEL FACINGS MAY BE SUSCEPTABLE TO STAINING DUE TO EXCESSIVE MOISTURE CREATED BY THE HYDRATION OF CONCRETE TYPE MATERIALS. THEREFORE, IT IS ABSOLUTELY NECESSARY THAT EACH ROOM BE PROPERLY VENTILATED. ALSO NOTE THAT SPECIAL PRECAUTIONS MUST BE TAKEN WHEN USING MURIC ACID DUE TO EFFECTS HYDROCHLORIC ACID FUMES HAVE ON ALUMINUM AND STAINLESS STEEL MATERIALS.

SCALE:	3/8"=1'-0"
DRAWING NO.:	P7-1010-C1
DRAWN BY:	SHW
DATE:	01/01/2008
DEALER:	
PROJECT:	9'-8" X 9'-8" X 7'-6 1/4"
2015 TENNESSEE AVENUE NORTH P.O. BOX 650 PARSONS, TN, 38363 (901) 847-6361	
<b>KOLPAK</b> WALK-INS	